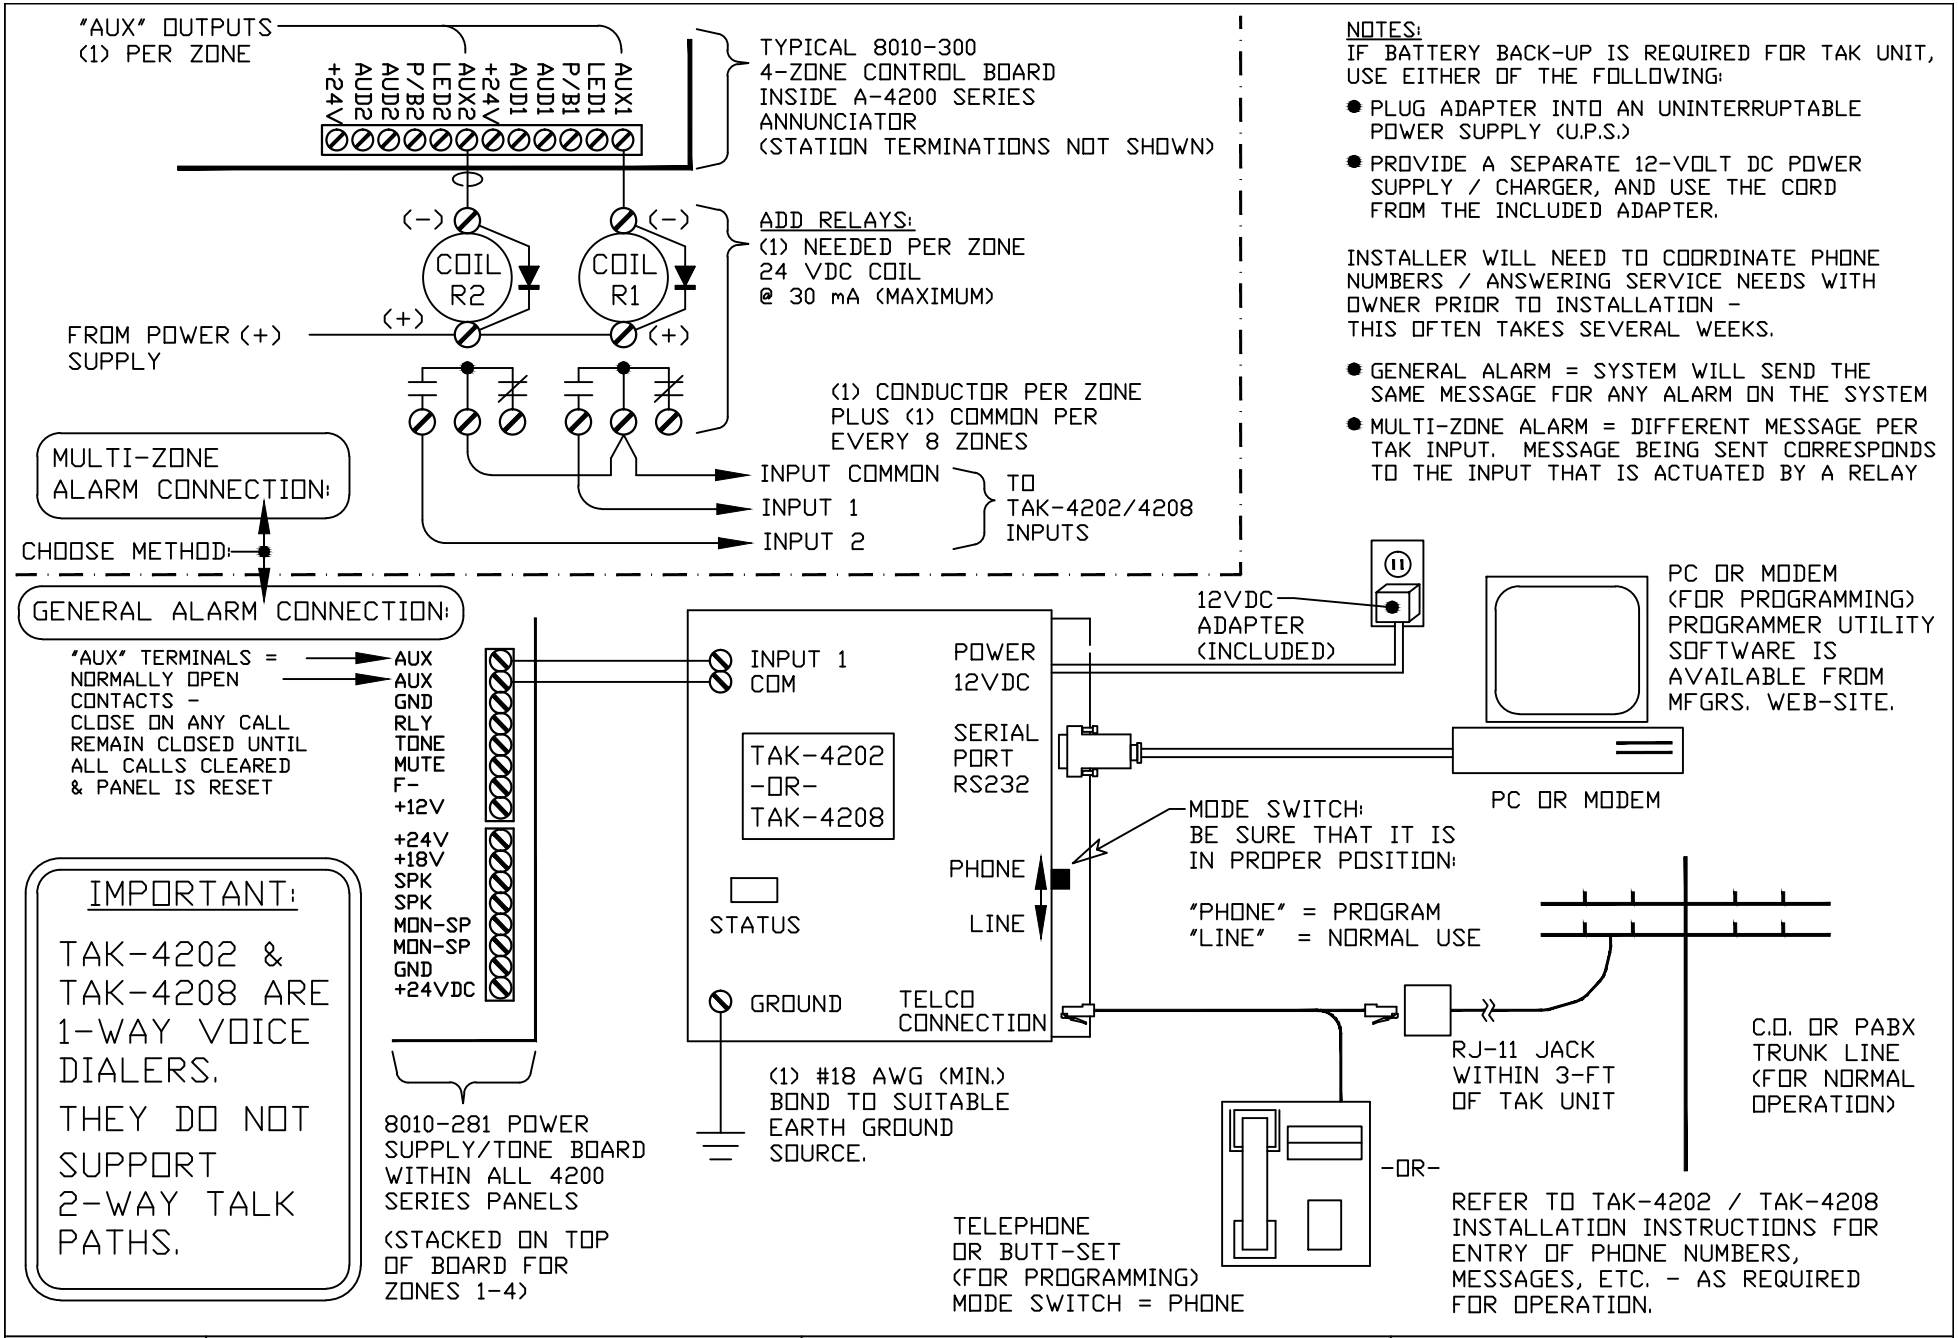

NOTES:
IF BATTERY BACK-UP IS REQUIRED FOR TAK UNIT, USE EITHER OF THE FOLLOWING:

- PLUG ADAPTER INTO AN UNINTERRUPTABLE POWER SUPPLY (U.P.S.)
- PROVIDE A SEPARATE 12-VOLT DC POWER SUPPLY / CHARGER, AND USE THE CORD FROM THE INCLUDED ADAPTER.

INSTALLER WILL NEED TO COORDINATE PHONE NUMBERS / ANSWERING SERVICE NEEDS WITH OWNER PRIOR TO INSTALLATION - THIS OFTEN TAKES SEVERAL WEEKS.

- GENERAL ALARM = SYSTEM WILL SEND THE SAME MESSAGE FOR ANY ALARM ON THE SYSTEM
- MULTI-ZONE ALARM = DIFFERENT MESSAGE PER TAK INPUT. MESSAGE BEING SENT CORRESPONDS TO THE INPUT THAT IS ACTUATED BY A RELAY

IMPORTANT:

TAK-4202 & TAK-4208 ARE 1-WAY VOICE DIALERS.

THEY DO NOT SUPPORT 2-WAY TALK PATHS.

CORNELL Communications, Inc.
sales@cornell.com 414-351-4660
Web: www.cornell.com 414-351-4657(fax)

DATE: MAY 22, 2013	**SYSTEM: 4200 RESCUE ASSISTANCE**	
TITLE: TELEPHONE ACCESS KIT	**DRAWING # 90068-13**	**DTAK4200W**