




115VAC, 60HZ @ 1.15 AMP

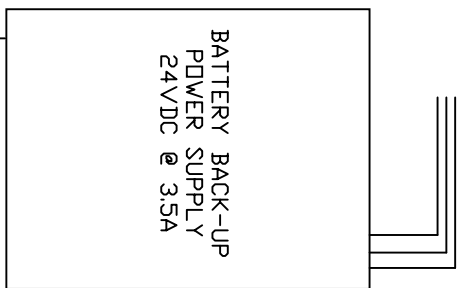

18AWG 2 COND. CABLE

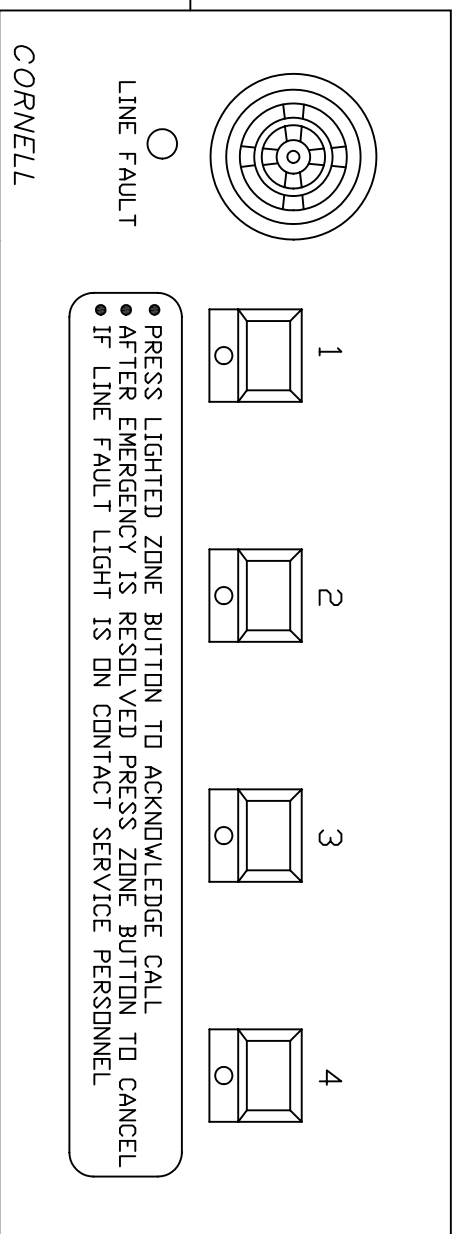

ONE, 22AWG, 4 CONDUCTOR,  
NON-SHIELDED CABLE  
REQUIRED PER ZONE

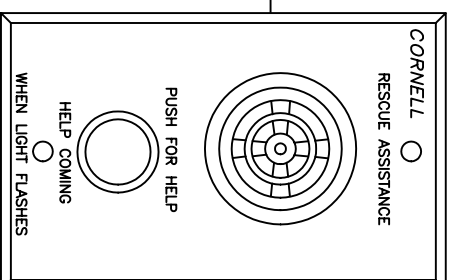

**CORNELL Communications, Inc.**  
 sales@cornell.com 414-351-4660  
 Web: www.cornell.com 414-351-4657(fax)

**DATE: JANUARY 21, 2003**  
**TITLE: 4100 SYSTEM LAYOUT**

**SYSTEM: 4100**  
**DRAWING # 90030-03**



